
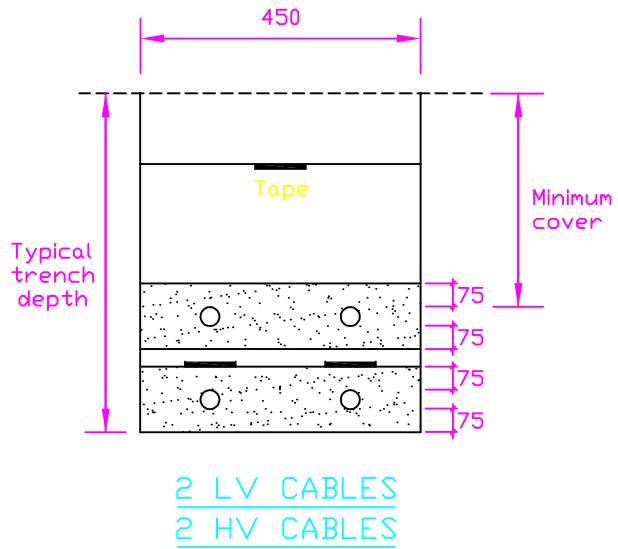
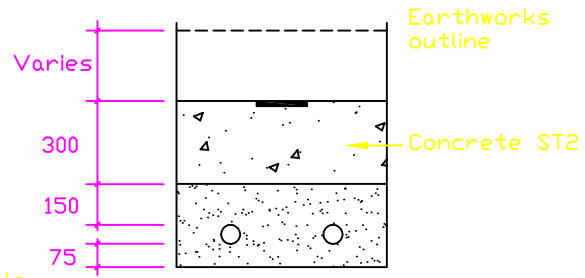
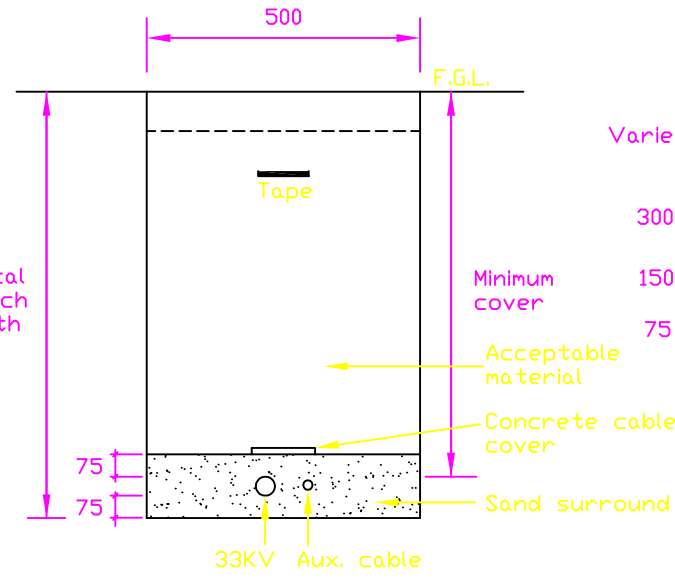


NOTES

1. All dimensions are in millimetres unless otherwise stated.
2. Tape to be positioned 200mm below finished footpath / verge level or 200mm below formation level in road.
3. Cables to be laid as per Hydro Electric Underground Installation Manual.

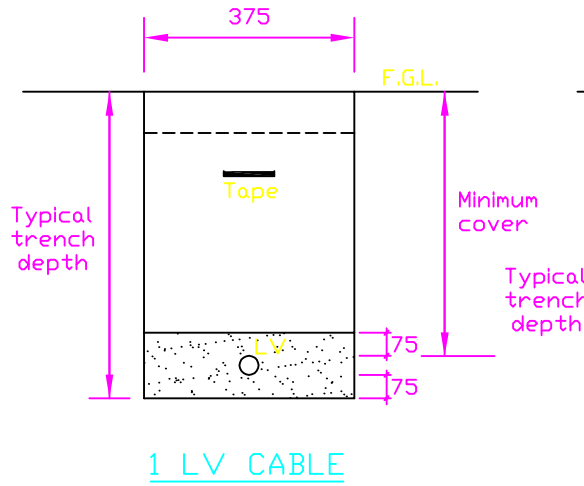

Cable	Depth of trench		Min. Cover of Cable	
	Footpath or Verge	Road	Footpath or Verge	Road
33KV	1150	1150	1000	1000
11KV	850	975	750	850
LV	550	850	450	750
Service	500	850	450	750

No.	Date	Description
↑		AMENDMENTS
↓		